

# Geothermal energy: Power plant technology and direct heat applications

Diego Moya<sup>a,b,c,\*</sup>, Clay Aldás<sup>d</sup>, Prasad Kaparaju<sup>e,\*\*</sup>

<sup>a</sup> Institute for Applied Sustainability Research (iSUR), Av. Granados E13-55 e Isla Marchena, No.44, 170503, Quito, Ecuador

<sup>b</sup> Carrera de Ingeniería Mecánica, Facultad de Ingeniería Civil y Mecánica, Universidad Técnica de Ambato, Av. Los Chasquis y Río Payamino, 1801314, Ambato, Ecuador

<sup>c</sup> Department of Chemical Engineering, and the Grantham Institute – Science and Solutions for a Changing Planet DTP, Imperial College London, London SW7 2AZ, UK

<sup>d</sup> Facultad de Ingeniería en Sistemas, Electrónica e Industrial, and the Renewable Energy and Web Architecture – Research & Development (REWA-RD) group, Universidad Técnica de Ambato, Av. Los Chasquis y Río Payamino, 1801314, Ambato, Ecuador

<sup>e</sup> Griffith School of Engineering, Griffith University, Nathan Campus, 4111 Queensland, Australia

## ARTICLE INFO

### Keywords:

Geothermal energy  
Power plant technology  
Single-flash  
Double-flash  
Dry-steam  
Binary  
Direct uses  
Cascade applications  
Hybrid geothermal configurations

## ABSTRACT

The transition from current fossil-fuel energy system towards a sustainable one-based requires renewable energy technology. Although geothermal energy presents its own particular challenges in comparison with other renewable energy technologies, geothermal energy has showed significant potential to reduce environmental impact and greenhouse gas emissions from electricity production. Advantages of geothermal energy are not only the generation of electricity in different plant configurations but also the direct application of heat in industry and household uses regardless of meteorological conditions. In this study, a research review is carried out on the aspect of geothermal energy development, assessing power plant technology and direct heat applications. Five power plant configurations are studied: single-flash, double-flash, dry-steam, binary and advanced. The thermodynamic aspects are addressed in order to consider them for future geothermal power plant analysis. Furthermore, the most common direct uses of geothermal heat are discussed. Results illustrate that Binary – Organic Ranking Cycle Power Plants might play a vital role in the exploitation of low temperature geothermal resources. Furthermore, it is identified a need for research in hybrid geothermal-solar-biomass configurations for poly-generation purposes. These configurations increase the energy output, increasing the thermal efficiency and increasing the life of the geothermal reservoir. Similarly, direct applications of geothermal heat present good opportunities for increasing the revenue of a geothermal project. Depending of the geographic zone, cascade configurations contributes to maximise the use of geothermal resources. Future research reviews should consider the financial, economic and policy aspects of geothermal developments along with the geology, geophysics, geochemistry, drilling, reservoir engineering and environmental aspects. The main goal of addressing these topics is to provide the state-of-the-art of geothermal development for developers, policy makers, researchers and communities interested in geothermal energy.

## 1. Introduction

Worldwide, the transition from current fossil-fuel-dependent energy system towards a sustainable one based primarily on renewable resources requires proofed green-technology evidence-based decision-making [1]. Technology transfer and development of new technologies are vital for sustainable development and climate change mitigation [2]. Geothermal energy has showed significant potential as renewable

energy resource because of its low environmental impact, low greenhouse gas emissions and technology feasible [3,4]. Moreover, geothermal resources can be exploited regardless of meteorological conditions [5,6].

Geothermal energy is an indigenous environmentally benign source of renewable heat contained in the Earth's interior [7,8] commonly associated with volcanic and tectonic activity [9]. This heat is primarily stored in hot rocks at high depths from the earth's surface [10,11], and

**Abbreviations:** FAM, Financial Analysis model; SRAM, Sensitivity and Risk Analysis Models; NPV, Net Present Value; UNFCCC, United Nations Framework Convention on Climate Change; IGA, International Geothermal Association; WB, World Bank; MW, Megawatt; kW, Kilowatt; kWh, Kilowatt-hour; kg/s, Kilogram per second; kg/h, Kilogram per hour; °C, Centigrade degree; %, Percentage; bar, Bar; yr, Year; kPa, Kilopascal; USD, United State Dollars; Mtoe, Millions tons of oil equivalent; GHG, Greenhouse gas emissions; GJ, Gigajoules; tCO<sub>2</sub>, Tonnes of carbon dioxide; CH<sub>4</sub>, Methane; N<sub>2</sub>O, Nitrous oxide; Ctv, Cents of dollar; EGS, Enhanced geothermal systems; T&D, Transmission and distribution

\* Corresponding author at: Carrera de Ingeniería Mecánica, Facultad de Ingeniería Civil y Mecánica, Universidad Técnica de Ambato, Av. Los Chasquis y Río Payamino, Ambato, 1801314, Ecuador.

\*\* Corresponding author.

E-mail addresses: [da.moya@uta.edu.ec](mailto:da.moya@uta.edu.ec), [d.moya17@imperial.ac.uk](mailto:d.moya17@imperial.ac.uk) (D. Moya), [p.kaparaju@griffith.edu.au](mailto:p.kaparaju@griffith.edu.au) (P. Kaparaju).

<https://doi.org/10.1016/j.rser.2018.06.047>

Received 24 April 2017; Received in revised form 11 May 2018; Accepted 20 June 2018

Available online 07 July 2018

1364-0321/ © 2018 Elsevier Ltd. All rights reserved.

it is also found in complex structures of hydrothermal reservoirs at high temperatures [12]. Many authors agree that geothermal energy is a renewable energy resource [8,13–17]. However, the speed of exploitation of geothermal reservoirs is usually faster than the replacement of its heat on depending on geologic time scale, geothermal applications and methods of heat reinjection [18].

Overall, brine has been characterised as a heat medium which can be used either for fluid and vapour or steam. Furthermore, scientists in geochemistry and thermo-fluids have classified geothermal fluids in two types: steam (vapour-dominated systems) and mineral-laden hot water also called 'brine' [19]. These fluids transport the geothermal heat stored underground into the surface, for electricity generation and non-electricity (direct uses) purposes, through wells drilled into the localised high-temperature geothermal reservoir [20]. Depending on the features of the reservoir, depths of production wells range from 300 m to more than 3000 m where thermo-fluids are naturally contained in porous hot rock of the hydrothermal and geo-pressured geothermal reservoirs [18].

Then, free flow or pumping, depending on the reservoir characteristics, is applied to extract the hot native fluids (brine). In order to optimally use the valuable heat, different management techniques of geothermal fluids (including surface hot water - brine) uses are needed [9,21,22]. Finally, different configurations of the power conversion system convert the geothermal heat flow into electricity [7,23–26] or other direct heating purposes [20,26–31]. In this regard, the main focus of this study is to review the power conversion and direct use configurations to harvest energy from geothermal energy resources along with their economics implications.

Currently, the total installed capacity worldwide of geothermal power plants is 12.729 MW and forecasted to be 21.443 MW by 2020. Geothermal power plant is classically defined as binary (14%), back pressure (1%), single flash (41%), double flash (19%), triple flash (2%) and dry steam plant (23%) [32]. Similarly, the global installed thermal capacity is 70.885 MWT distributed in nine direct-use geothermal energy applications [33].

The Geothermal handbook developed by the Energy Sector Management Assistance Program (ESMAP), The World Bank Group (WBG), establishes eight stages of a geothermal development project, Fig. 1 [34]. Particularly, this work explores the up-to-date geothermal power plant technologies and direct heat applications, discussing the need for researching and developing new geothermal configurations. Some of the new configurations discussed are geothermal-other-energy-source hybrid systems and cascade configurations to maximise the use of the geofluid. Next works should present the necessary policy development, financial aspects and economic impact of geothermal projects, along with the geo-scientific assessment of geothermal resources.

## 2. Geothermal power plant technology

Based on the availability of exploitable hydrothermal resources, a large number of technologies and power plant configurations have been studied [14,26,35,36]. In general, researchers agree that five power configurations have been developed for geothermal plants: 1. dry steam, 2. single flash, 3. double flash, 4. binary (Organic Rankine - Kalina Cycle), and 5. advanced geothermal energy conversion systems (hybrid single-double-flash systems - triple flash, hybrid flash-binary systems, hybrid fossil-geothermal systems, hybrid other-renewable heat source-geothermal systems, and hybrid back pressure system)

[24,37,38]. However, Valdimarsson [36] suggests that geothermal power plants can be classified into two groups, steam cycles for higher well enthalpies and binary cycles for lower enthalpies. This paper assesses the five configurations mentioned before.

### 2.1. Single-flash steam power plants

The single-flash steam power plant is a relatively simple geothermal energy–electricity conversion configuration when geothermal production wells are producing a mixture of steam and brine [14]. A cylindrical cyclone pressure vessel separates the mixture into two distinct phases, steam and liquid, due to their naturally large density difference [18,36,39]. DiPippo [14] and Valdimarsson [36] indicate that the term 'single' indicates a single flashing process in the geo-fluid (transition from pressurised liquid to liquid-vapour mixture), which is produced as a result of lowering the geothermal fluid pressure and occurs either in the reservoir, production wells or cyclone inlet. Five to six production wells and two to three re-injection wells distributed across the geothermal reservoir are typically required for a 30 MW single-flash geothermal power plant [14]. Piping systems are additionally used to gather and transport the mixture from production wells to the powerhouse, although the steam's pressure drop as a result of pipe friction is a critical concern in these gathering systems [40]. Due to the complexity and reliability needed to analytically predict the pressure loss, empirical correlations are required taking into account pipe diameter, length, piping configurations, density and mass flow rate of steam. These variables not only affect the efficiency of the energy conversion system, but also the cost of the power plant [14,40,41]. Once the steam and liquid are separated, the obtained steam (generally 99.995% dry) drives an assembled turbine-generator producing electricity [14]. Braun and McCluer [18] explain that a single-flash process is selected if the temperature of the geothermal fluid is greater than 260 °C, reaching a capacity factor of 95–100%.

Fig. 1 illustrates a schematic diagram of the energy conversion system of the single-flash process. The single-flash steam power process starts in station 1, where the geo-fluid enters the production well at the source inlet temperature. There is a pressure drop between station 1 and 2 producing that the fluid initiates to boil (mixture steam-liquid) before entering the separator in station 2. The separator divides the mixture fluid into steam (station 5) and brine (station 3) which is re-injected in station 4.

The steam, in station 5, enters the turbine which is coupled to a generator to produce electricity by induced movement from the turbine. Steam expansion is then produced through the turbine down to station 6 at condenser pressure. An air cooler condenser may be used to allow cooling air at station c1 and leaving at station c2 [14,36]. DiPippo [14], Yildirim [43] and Zarrouk and Moon [40] identify that certain plant equipment is necessary to run the single-flash steam geothermal power plant, as can be seen in Fig. 2. This power plant configuration does not require large amount of fresh water for cooling [14,44,45]. A portion of the condensed steam is used in the cooling tower to obtain cooling water, especially for dry regions with a lack of fresh water [40].

The conversion process of a single-flash steam geothermal power plant is best visualised using a thermodynamic state diagram, Fig. 3. Çengel and Boles [46] state that the analysis of the process using that diagram is conducted taking into account two fundamental thermodynamic principles, the principle of energy conversion and the principle of mass conversion. In Fig. 3, the T-s state diagram illustrates the



Fig. 1. Schematic representation of the eight stages of geothermal development by ESMAP-WBG [34].

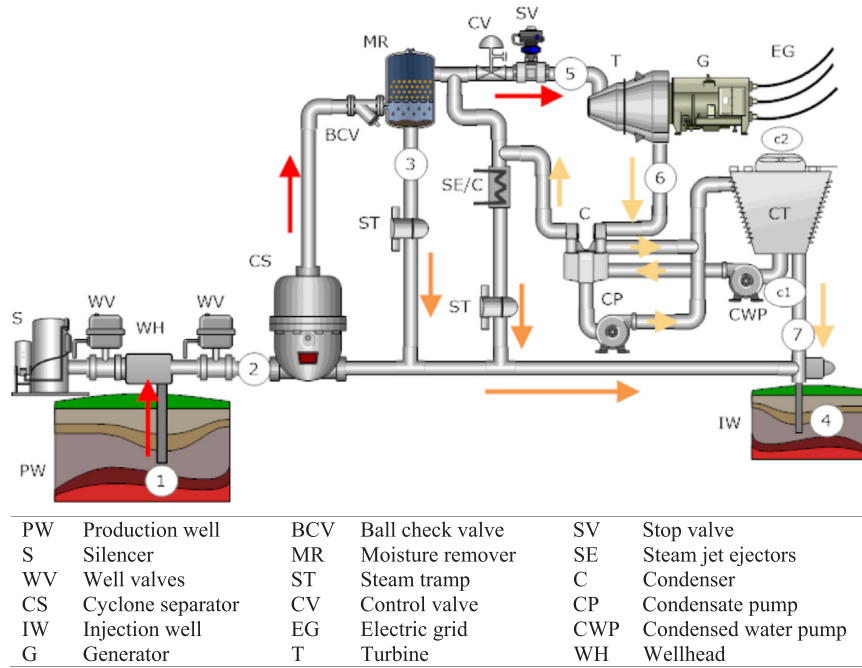


Fig. 2. Single flash geothermal power cycle [14,36,42].

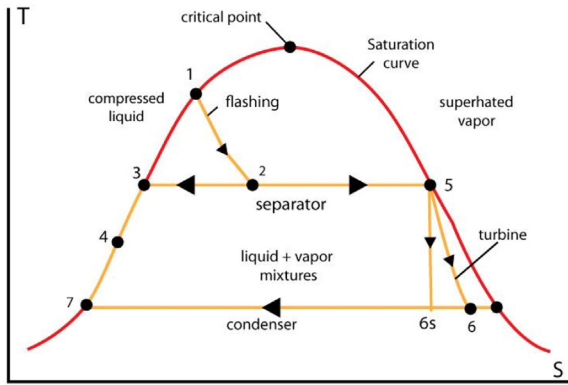


Fig. 3. General thermodynamic diagram, temperature-entropy (T-s), of a single flash cycle [14].

process for a single-flash power plant. At state 1, close to saturation curve, the *flashing process* takes place when the geothermal fluid under pressure initiates the process. In this state, the change in the kinetic or potential energy is neglected, and the enthalpy ( $h$ ) is modelled as constant,  $h_1 = h_2$ , Eq. (1), Table 1. The *separation process* takes place at state 2 after the flashing process and is modelled at constant pressure. In this state, a mixture of liquid plus vapour is presented determining the quality of the mixture. This quality is given by the dryness fraction ( $x_2$ ) shown in Eq. (2). As a result, the steam mass fraction is given and represents the amount of steam going to the turbine. Then, the *turbine expansion process* produces work ( $w_1$ ) between states 4 and 5, given by Eq. (3). In the thermal fluid entering and leaving the turbine, no heat losses are assumed and changes in kinetic and potential energy are neglected. The ideal process is from 4 to 5, thus, the isentropic turbine efficiency is defined by,  $\eta_t$ , the ratio of the actual work to the isentropic work as is illustrated in Eq. (4). The gross mechanical power ( $\dot{W}_t$ ) developed by the turbine is represented by Eq. (5) and the electrical power ( $\dot{W}_e$ ) is given by Eq. (6), which is equal to the generator efficiency ( $\eta_g$ ) multiplied by the turbine's mechanical power. Finally, the condensing and cooling processes take place between state 5 and 6. The required flow rate of cooling water is given by Eq. (7) [7,36].

The Second Law of Thermodynamics is assessed in order to

determine the entire plant performance [40]. This law compares the actual power output produced at the end of the single-flash steam process to the maximum theoretical power that the geothermal fluid could produce [14]. The specific exergy requires to be defined and modelled. The Second Law of Thermodynamics defines exergy as the energy that is available to be used; therefore, it is the potential to convert energy into work [40,44]. Exergy ( $e$ ), of a geothermal fluid that has a temperature ( $T$ ) and a pressure ( $P$ ), under an ambient temperature ( $T_o$ ) and ambient pressure ( $P_o$ ), is given by Eq. (8), Table 2. The multiplication of exergy by the total geothermal mass flow rate will result in the maximum theoretical thermodynamic power, also called the exergetic power (Eq. (9)). Lastly, the entire power plant efficiency is given by the ratio of the net power of the single-flash steam power plant to the exergetic power (Eq. (10)) [14,46].

Environmental impacts are potentially identified in specific places of a single-flash geothermal power plant at normal operation [14]. The main places where emission may occur are: at the wellhead (provides structural interface between wells and production equipment); at the silencers and mufflers; at the steam traps; at the pipeline drains; at the ejector vents; and at the cooling tower [14,43,45]. Overall, DiPippo [39] identified that steam from geothermal reservoirs may contains a mixture of non-condensable gases, for example, carbon dioxide ( $\text{CO}_2$ ), methane ( $\text{CH}_4$ ) and hydrogen sulphide ( $\text{H}_2\text{S}$ ). Commonly, these gases are isolated and treated before release to the atmosphere [47]. DiPippo [14] also clarifies that although  $\text{CO}_2$  is released from a single-flash power plant, it constitutes an insignificant greenhouse gas source (0.06 kg/kWh) in comparison with a natural-gas-fired power plant (0.59 kg/kWh) or a coal-fired power plant (1.13 kg/kWh).

## 2.2. Double flash steam power plants

The double-flash steam geothermal power plant has been also developed for an energy–electricity conversion configuration when geothermal production wells are producing a mixture of steam and liquid [48]. DiPippo [14], pp. 112, indicates that ‘the double-flash power plant is an improvement on the single-flash design’ reaching up to ‘25% more power output for the same geothermal fluid conditions’. He also explains that although these kinds of plants are more expensive, more complex and require more operation and maintenance, the power

**Table 1**  
Equations used for thermodynamic state analysis [14].

| State                     | Main characteristics                               | Eqs.                                                                        |
|---------------------------|----------------------------------------------------|-----------------------------------------------------------------------------|
| Flashing process          | Constant enthalpy                                  | $h_1 = h_2$ (1)                                                             |
| Separation process        | Constant pressure<br>Mixture of liquid plus vapour | $x_2 = \frac{h_2 - h_3}{h_4 - h_3}$ (2)                                     |
| Turbine expansion process | Constant entropy                                   | $w_1 = h_4 - h_5$ (3)                                                       |
|                           |                                                    | $\eta_t = \frac{h_4 - h_5}{h_4 - h_{5s}}$ (4)                               |
|                           |                                                    | $\dot{W}_t = \dot{m}_5 w_t$ (5)                                             |
|                           |                                                    | $\dot{W}_e = \eta_g \dot{W}_t$ (6)                                          |
| Condensing process        |                                                    | $\dot{m}_{cw} = x_2 \dot{m}_{total} \frac{h_5 - h_6}{\bar{c} \Delta T}$ (7) |

**Table 2**  
Exergy equations and power plant efficiency [14,46].

| Thermodynamic dimension       | Eqs.                                                                      |
|-------------------------------|---------------------------------------------------------------------------|
| Exergy                        | $e = h(T, P) - h(T_0, P_0) - T_0 [s(T, P) - s(T_0, P_0)]$ (8)             |
| Exergetic power               | $\dot{E} = \dot{m}_{total} e$ (9)                                         |
| Entire power plant efficiency | $\eta_u = \frac{\dot{W}_{net}}{\dot{E}} = \frac{\dot{W}_e}{\dot{E}}$ (10) |

output justifies their installation. The addition of a secondary flash process is a significant improvement regarding the more efficient utilisation of the geothermal resource [39]. After the first pressure drop in the primary separator (single-flash process), a second pressure drop is applied in a second flash process (second separator) generating additional steam from the separated liquid leaving the first separator [14,39]. Then, lower-pressure steam is produced, which is admitted to the coupled turbine-generator at an appropriate turbine stage generating extra power [39] or to a different turbine depending on the configuration [43]. Chamorro, Mondéjar [45] indicate that this optimisation maximises the entire exergy efficiency of the double-flash power plant. The main component, therefore, is the geothermal steam-water separator. A complete design overview of horizontal separator and vertical cyclone separator for flashed-steam geothermal power plants has been conducted by Zarrouk and Purnanto [19]. Although the exergy efficiency is increased and is calculated differently compared with single-flash, other assumptions made in single-flash plants, such as calculations of turbine work, quality of the mixture and the entire power plant efficiency, are valid for double-flash designs [14,43,45].

In comparison with the single-flash system (Fig. 2), the main difference in the double-flash configuration (Fig. 4) is the addition of a low-pressure separator and the dual-admission turbine. The low-pressure steam is admitted to the turbine at an appropriate stage in order to produce a smooth combination with the expanded high-pressure steam [14]. Fig. 4 illustrates the energy conversion process of a double-flash steam geothermal power plant. The double-flash steam power process starts in station 2, where the geo-fluid enters the production well at the source inlet temperature. There is a pressure drop between station 1 and 2 producing that the fluid starts to boil (mixture steam-liquid) just before entering the separator in station 2. Then, the first flashed-steam process occurs. The separator divides the mixture fluid first into a high-pressure steam (station 5) and brine (station 3) which is throttled down

to a lower pressure level at station 8. As a result, the second flashed-steam process takes place. The low-pressure separator receives the brine and by a second pressure drop a new mixture (steam-brine) is produced. The second new low pressure steam is transported to the turbine at the second steam admission at station 9. The first high pressure steam, at station 5, firstly enters the turbine at the primary steam admission. The dual-admission turbine is coupled to a generator to produce electricity by induced movement. Steam expansion is then produced through the turbine down to station 6 at condenser pressure [14,36]. Additionally, Valdimarsson [36] argues that the design process of the turbine requires having the same pressure difference on the first stage-admission of the turbine and the same pressure difference between the high and low separators. Therefore, a higher mass flow is required in the lower pressure stage than in the high-pressure stage. An air cooler condenser may be used introducing cooling air at station c1 and leaving at station c2 to condense the remaining hot fluids at station 6. Finally, the remaining brine from the second flashed process at station 10, along with the condensed fluid at station 7 are re-injected at station 4.

The thermodynamics of the energy-electricity conversion process of the double-flash geothermal power plant is better explained by using the temperature-entropy (T-s) diagram (Fig. 5). The striking characteristic of this process is the two flash processes taking place in 1–2 and 3–6 states, and these *double-flash process* are analysed individually as a single-flash process [14,36]. Eqs. (11)–(14), in Table 3 are used to determine the fractional amount of produced steam in the mixtures leaving the separators at each flashed process ( $x_2$  in 1–2 state and  $x_6$  in 3–6 state – the separation process).

In addition, four equations are implemented to determine the mass flow rates of the steam (state 2) and brine (state 6) produced in the separation processes at the high and low pressure stages respectively. The expressions are Eqs. (15)–(18). The produced steam mass flow rate at high pressure ( $\dot{m}_{hps}$ , at state 5) is given by Eq. (15) and at low pressure ( $\dot{m}_{lps}$ , at state 8) is given by Eq. (17), while the produced brine mass flow rate at high pressure ( $\dot{m}_{hpb}$ , at state 3) and low pressure ( $\dot{m}_{lpb}$ , at state 7) are given by Eqs. (16) and (18) respectively. At state 9, the two steams (high and low pressured) come together to the low-pressure turbine stage. Four values will be calculated by using Eqs. (15)–(18): the power produced in the turbine; the heat rejected in the condenser, and in the cooling water, and the disposed waste liquid.

Two *turbine expansion processes* can be described in this system. The *first turbine expansion process* produces work ( $w_{hpt}$ ) between states 4 and 5, given by Eq. (19), and the *second turbine expansion process* produces work ( $w_{lpt}$ ) between states 9 and 10, given by Eq. (26). Consequently, two isentropic turbine efficiencies are defined for the high-pressure process ( $\eta_{hpt}$ ), Eq. (20), and low pressure process ( $\eta_{lpt}$ ), Eq. (30). The power generated in the first turbine stage at high pressure is given by



**Table 3**  
Thermodynamic equations for double-flash geothermal power plants [14,36].

| State                         | Main characteristics                                         | Equations                                                                                                         |
|-------------------------------|--------------------------------------------------------------|-------------------------------------------------------------------------------------------------------------------|
| Flashing process 1            | Constant enthalpy                                            | $h_1 = h_2$ (11)                                                                                                  |
| Separation process 1          | Constant pressure<br>Mixture of liquid plus vapour           | $x_2 = \frac{h_2 - h_3}{h_4 - h_3}$ (12)                                                                          |
| Flashing process 2            | Constant enthalpy                                            | $h_3 = h_6$ (13)                                                                                                  |
| Separation process 2          | Constant pressure<br>Mixture of liquid plus vapour           | $x_6 = \frac{h_3 - h_7}{h_8 - h_7}$ (14)                                                                          |
| Produced steam mass flow rate | High pressure                                                | $\dot{m}_{hps} = x_2 \dot{m}_{total} = \dot{m}_4 = \dot{m}_5$ (15)                                                |
| Produced brine mass flow rate | High pressure                                                | $\dot{m}_{hpb} = (1-x_2)\dot{m}_{total} = \dot{m}_3 = \dot{m}_6$ (16)                                             |
| Produced steam mass flow rate | Low pressure                                                 | $\dot{m}_{lps} = (1-x_2)x_6\dot{m}_{total} = \dot{m}_8$ (17)                                                      |
| Produced brine mass flow rate | Low pressure                                                 | $\dot{m}_{lpb} = (1-x_2)(1-x_6)\dot{m}_{total} = \dot{m}_7$ (18)                                                  |
| Turbine expansion process     | High pressure stage<br>(Eqs. 22 and 23 are the Baumann rule) | $w_{hpt} = h_4 - h_5$ (19)                                                                                        |
|                               |                                                              | $\eta_{hpt} = \frac{h_4 - h_5}{h_4 - h_{5s}}$ (20)                                                                |
|                               |                                                              | $\dot{W}_{hpt} = \dot{m}_{hps} w_{hpt} = x_2 \dot{m}_{total} w_{hpt}$ (21)                                        |
|                               |                                                              | $h_5 = \frac{h_4 - A \left[ 1 - \frac{h_7}{h_8 - h_7} \right]}{1 + \frac{A}{h_8 - h_7}}$ (22)                     |
|                               |                                                              | $A = 0.425(h_4 - h_{5s})$ (23)                                                                                    |
|                               |                                                              | $\dot{m}_5 h_5 + \dot{m}_8 h_8 = (\dot{m}_5 + \dot{m}_8) h_9$ (24)                                                |
|                               |                                                              | $h_9 = \frac{x_2 h_5 + (1-x_2)x_6 h_8}{x_2 + (1-x_2)x_6}$ (25)                                                    |
|                               |                                                              | $w_{lpt} = h_9 - h_{10}$ (26)                                                                                     |
|                               |                                                              | $\dot{W}_{lpt} = \dot{m}_9 (h_9 - h_{10})$ (27)                                                                   |
|                               |                                                              | $h_{10} = \frac{h_9 - A \left[ x_9 - \frac{h_{11}}{h_{12} - h_{11}} \right]}{1 + \frac{A}{h_{12} - h_{11}}}$ (28) |
|                               |                                                              | $A = 0.425(h_9 - h_{10s})$ (29)                                                                                   |
|                               |                                                              | $\eta_{lpt} = \frac{h_9 - h_{10}}{h_9 - h_{10s}}$ (30)                                                            |
|                               |                                                              | $\dot{W}_{total} = \dot{W}_{hpt} + \dot{W}_{lpt}$ (31)                                                            |
|                               |                                                              | $\dot{W}_{e, gross} = \eta_g \dot{W}_{total}$ (32)                                                                |

contact between the geo-fluid and power production equipment may prevent scaling and corrosion effects. However, Dickson and Fanelli [49] emphasised that binary system designs can utilise a temperature range between 85 and 170 °C, stating that upper limited temperatures depend on working fluid thermal stability and lower limited temperatures on technical, financial and economic aspects. The secondary fluid (working fluid) in the binary system operates under a conventional Ranking cycle [50], and as the used working fluid is organic, the binary cycle is also known as the Organic Ranking Cycle (ORC).

The secondary cycle allows binary power plants to be versatile. Yari [44] exemplifies this versatility identifying various types of binary power plants configurations such as B-GPP using ORC with internal heat exchanger (IHE), B-GPP with regenerative ORC and B-GPP with regenerative ORC using IHE. Another technical variation in B-GPP was patented by Kalina AI in 1982; the Kalina cycle uses the thermodynamic properties of ammonia–water mixture as a working fluid allowing different binary configurations [51,52]. The remarkable feature of the Kalina cycle is the efficiency improvement in geothermal power cycles achieving between 30% and 40% more thermal efficiency than typical B-GPPs [50].

Fig. 8 exemplifies the energy conversion system of a basic binary geothermal power plant, which applies a closed loop of a thermodynamic Rankine cycle. Highlighting the main characteristics of the process, pumps (P) are used to extract the geothermal heat flow through

the production wells (PW), and pass through different components of the primary cycle. The geo-fluid commonly undergoes sand removers (SR) to prevent scouring and erosion in piping and tubes. The fluid continues its flow through the evaporator (E) and preheater (PH), and finally an injection pump (IP) reinjects the geothermal heat flow into the reservoir by the injection wells (IW).

On the secondary cycle, the working fluid encompasses two heating-boiling steps: firstly, the working fluid reaches its boiling point in the PH, and secondly, emerges as a saturated vapour after making contact (a heat exchange process) with the E. Then, the resulting saturated vapour of the working fluid expands in the turbine, condenses and returns to the evaporator, closing the loop system and starting the process again [14,36,39,50,52]. DiPippo [14] explains that the geothermal heat flow is kept above the flash pressure point in order to avoid the breakout of steam and calcite scaling in the piping system. This binary-type energy conversion configuration permits the exploitation of low-temperature geothermal resources under many different technical variations depending on technical features in order to reach remarkably high plant efficiencies [53].


The main thermodynamic characteristics of the secondary working fluid in the Organic Ranking cycle are that, at low temperatures (85 and 170 °C), it has a low boiling point and high vapour pressure [50]. To explain these thermodynamic features, pressure-enthalpy and temperature-entropy diagrams are required (Fig. 9).

The thermodynamic process starts at state 1 where the working fluid at saturated vapour point enters the turbine expanding and producing work. The generator then generates electricity by using this work. The pressure and temperature of the saturated vapour decrease at estate 2 after turbine expansion. At constant pressure, the working vapour fluid goes into the condenser reducing its temperature and therefore condensing the fluid, at state 3. The cooling process of the working fluid takes place between state 3 and state 4 by using cooling water from the air-cooled cooling tower. This cooling stage changes the state of the working fluid from vapour to saturated liquid. Then, the working saturated liquid fluid is pumped back to the pre-heater (state 5) and evaporator (state 6), and the working fluid emerges as saturated vapour starting the cycle again at state 1 [14,36,50,54].

The thermodynamic analysis of the condenser, the turbine and the feed pump is the same as for flash or dry-steam plants. Table 5 summarises the Eq. to analyse a binary geothermal power plant. Eq. (37) calculates the work produced ( $w_t$ ) in the turbine expansion process, while Eq. (38) analyses the isentropic turbine efficiency ( $\eta_t$ ), and finally the turbine power ( $\dot{W}_t$ ) and the generator power ( $\dot{W}_g$ ) is calculated by Eqs. (39) and (40) respectively where  $\dot{m}_{wf}$  represents the working fluid mass flow rate and  $\eta_g$  is the generator efficiency. In the condensing process,  $\dot{Q}_c$  represents the rejected heat from the working fluid as a result of cooling. The power transferred from the feed pump ( $\dot{W}_p$ ) to the working fluid is given by Eq. (42). Three assumptions are required to analyse the heat exchange process in the preheater PH and evaporator E: well-insulated PH and E; steady flow; and negligible potential energy and kinetic energy [14]. Then, the thermodynamic system is governed by Eq. (43) where ‘a’ represents the geothermal heat flow inlet, ‘b’ the geothermal heat flow after E and ‘c’ after PH.

Eq. (46) analyses the evaporation heat transfer rate between both fluids the geothermal heat flow and the working fluid, where  $T_a$  is the known brine inlet temperature,  $T_b$  is found from the pinch-point temperature (minimum temperature difference between two fluids - given by the manufacturer) and the known  $T_s$ . Finally, the overall cycle can be analysed by Eqs. (48)–(50). The thermal efficiency of the entire cycle ( $\eta_{th}$ ) represents in Eq. (48) in terms of the thermal power input ( $\dot{Q}_{PH/E}$ ) and the thermal power rejected ( $\dot{Q}_c$ ) [14,36,44,46,54].

The selection of the working fluid is the most important issue during the design process of a B-GPP, which must consider the thermodynamic properties of both geo-fluid and working fluid, health, safety and environmental impact [14]. The selection of working fluids defines the B-

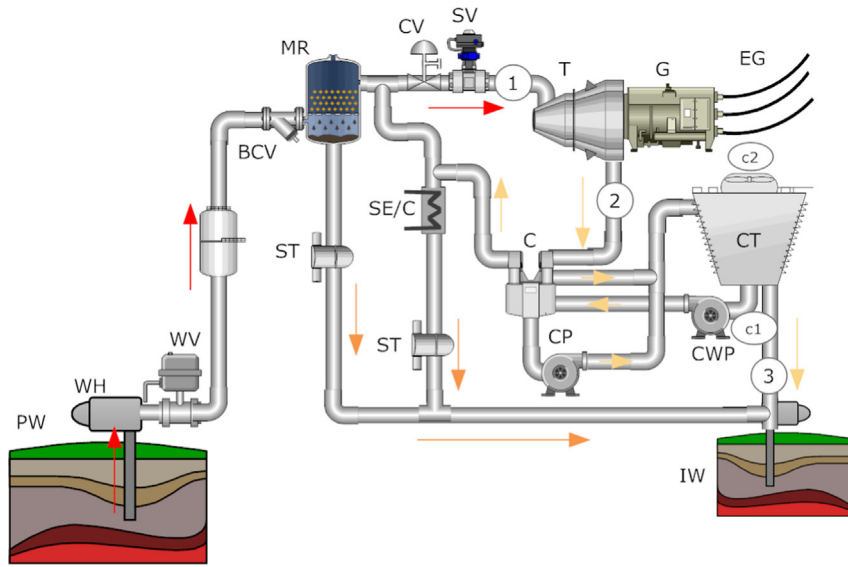

|    |                 |     |                  |     |                      |
|----|-----------------|-----|------------------|-----|----------------------|
| PW | Production well | BCV | Ball check valve | SE  | Steam jet ejectors   |
| WH | Wellhead        | MR  | Moisture remover | C   | Condenser            |
| WV | Well valves     | ST  | Steam tramp      | CP  | Condensate pump      |
| IW | Injection well  | CV  | Control valve    | CWP | Condensed water pump |
| EG | Electric grid   | SV  | Stop valve       | T/G | Turbine- Generator   |

Fig. 6. Dry-steam geothermal power plant [14,19,42].

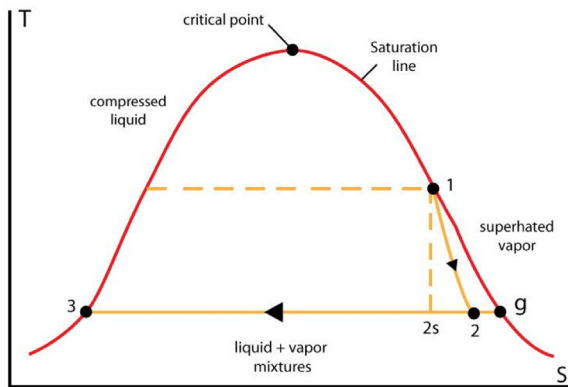


Fig. 7. Temperature – entropy (T-s) process diagram for a dry-steam power plant with saturated steam at the turbine inlet [14,45].

**Table 4**  
Thermodynamic equations in dry-steam process [14].

| State                     | Equations                                           |      |
|---------------------------|-----------------------------------------------------|------|
| Turbine expansion process | $w_t = h_1 - h_2$                                   | (33) |
|                           | $\eta_t = \frac{h_1 - h_2}{h_1 - h_{2s}}$           | (34) |
|                           | $\dot{W}_t = \dot{m}_s w_t = \dot{m}_s (h_1 - h_2)$ | (35) |
|                           | $\dot{W}_e = \eta_g \dot{W}_t$                      | (36) |

GPP system performance and economy [55]. Some working fluids are presented in Table 6, which clearly illustrates critical temperatures (CT) and critical pressures (CP) of working fluids are far lower than water. The versatile use of a secondary cycle in B-GPP has incurred in several variations of binary innovative systems, achieving improvements at higher efficiencies [14,25,44,56]. DiPippo [14], Yari [44] and Valdimarsson [27] explain different alternative configurations of the binary cycle such as the dual-pressure binary cycle, the dual-fluid binary cycle, the Kalina binary cycles and regenerative ORC.

A variety of approaches have been studied for working fluid selection in ORC-GPP. Quoilin, Declaye [57] presents a method which select the working fluid and an expansion machine in the same process. This tool selects the most suitable combinations of working fluid and expansion machine for a typical ORC systems. Mikielewicz [58] investigate 20 working fluids for ORC and conclude that R123 and R141b are the most suitable for small scale applications. Quoilin, Broek [59] additionally discuss the indicators that should be taken into account for selecting the most appropriate working fluid in a ORC: thermodynamic performance, isentropic saturation vapour curve, high vapour density, low viscosity, high conductivity, evaporating pressure, condensing gauge pressure, high temperature stability, melting point, low ozone depleting potential, low greenhouse warming potential, availability and low cost. Astolfi, Romano [60] conduct a detail study of Binary ORC power plants for the exploitation of medium–low temperature geothermal sources [61]. In part A, they investigate 54 working fluids in 6 different cycle configurations, concluding that, for low geothermal brine temperature (120 °C), the optimal fluid is decafluorobutane  $C_4F_{10}$ , and for higher temperature (180 °C), the optimal fluid is R236ea.

## 2.5. Advanced geothermal energy conversion systems – hybrid configurations

DiPippo [14] enumerates three well established advanced configurations of geothermal energy conversion systems: hybrid single-flash and double-flash systems, hybrid flash-binary systems and hybrid fossil-geothermal systems. Additionally, there is great interest in the development of hybrid power plants combining geothermal systems with biomass, waste-to-energy technologies, fuel cells and solar thermal systems [24,38,62–65]. Studies of Astolfi, Xodo [62], Peterseim, White [64] and Thain and DiPippo [24] seek to outline the main advantage of hybrid geothermal-other-renewable systems in aspects such as environmental impact, cost of electricity, exergy and plant efficiencies, turbo-machinery performance, techno-economic feasibility and investment risk. Regarding environmental impact of binary power plants, the geothermal heat flow is pumped and returned to the reservoir, and the working fluid never comes in chemical or physical contact with the

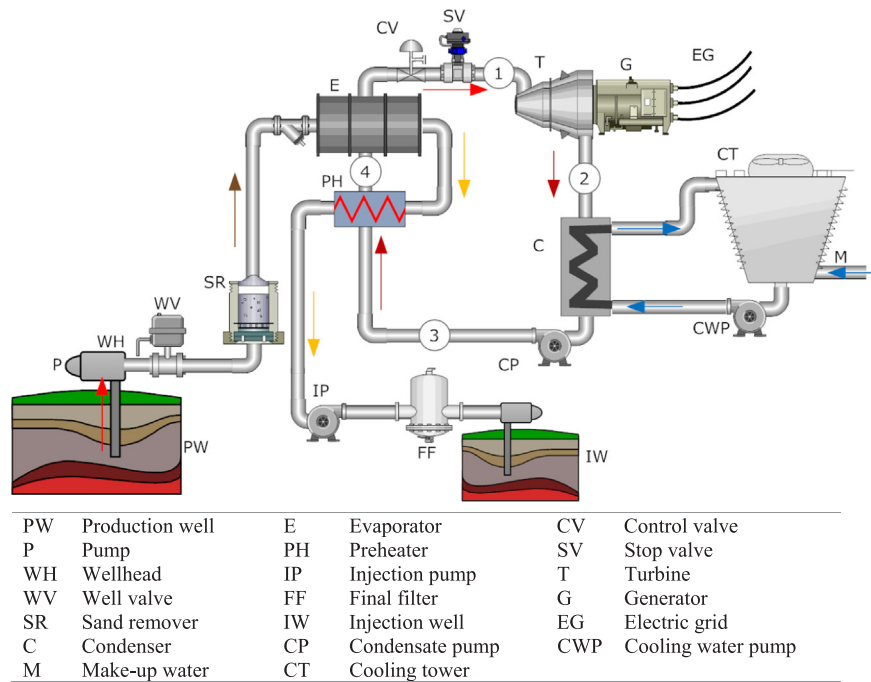


Fig. 8. Basic binary geothermal power plant [14,36,42,45].

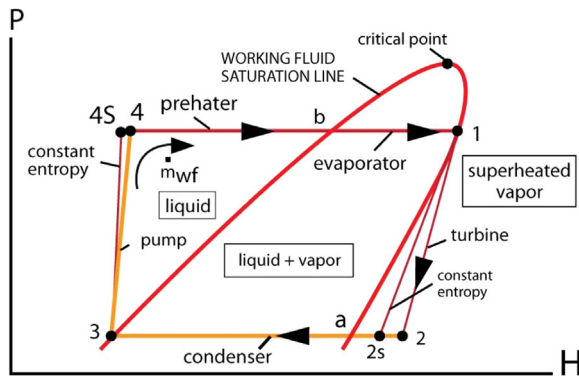


Fig. 9. Pressure-enthalpy diagram of a Binary geothermal power plant [14].

environment. Thus, thermal pollution is the only environmental impact, which takes place due to the heat rejected along with the cycle and is used for direct heating purposes [14,47].

Recent investigations are focusing on hybrid configurations of different thermal and non-thermal renewable with geothermal resources [24,38,62,66], although hybrid geothermal-fossil-fuels systems are not new [39,67]. Hybridisation of solar and geothermal energy in power plant configurations is current interest of research [68–75]. Jiang, Zhang [72] conduct a thermodynamic study of a Hybrid Solar-Enhanced Geothermal System Power Plant using  $\text{CO}_2$  as working fluid in a supercritical  $\text{CO}_2$  Brayton cycle. They conclude that the hybrid system has higher efficiency than the sum of the two stand-alone systems separately. While the geothermal cycle provides base-load electrical power, the solar system rises the capacity factor by generating additional electric power during peak demand hours. A recent study by Cardemil, Cortés [69] involved the performance analysis of a solar concentrating parabolic collector hybridised to a single and double-flash (triple flash) geothermal power plant for different geothermal reservoir conditions. Results demonstrate a 20% additional power output in the hybrid single-flash configuration along with 19% reduction on the consumption of the geothermal heat flow from reservoir in the hybrid double-flash configuration. Ayub, Mitsos [68] couple two existing models, an ORC geothermal model and a low-temperature solar

system. Results show a 2% decrease in the levelized energy cost for the hybrid system and although optimizing the ORC geothermal configuration an 8% reduction in the levelized energy cost is observed.

Zhou [67] carries out fundamental studies on hybrid geothermal energy systems. The feasibility study on a solar-geothermal hybrid configuration demonstrates a 12.7% increase in the power plant performance in the net electrical output and a 7.5% increase in the thermal efficiency [76]. Another work by Zhou, Doroodchi [75] show that a 20% reduction in the cost of electricity production can be achieved by a hybrid solar-geothermal power plant instead of use a stand-alone Enhanced Geothermal System. Back pressure systems are the simplest and the lowest overall thermal efficiency of the geothermal power plants. These requires less investment in comparison with the other technologies. These technologies are largely used in multiple use applications such as combined electricity and hot water production. In the mineral mining industry, back pressure systems provide temporary power during resource development where energy efficiency has low priority. Hybrid technologies is the most common application of these systems. Stand-alone scope of uses covers a temperature range from about 320 °C to some 200 °C. Thermodynamically, with a solar exergy fraction of more than 66%, the annual electricity production increases 15% and 19% for a subcritical and supercritical ORC solar-geothermal plant, respectively [67,74,75].

For low-enthalpy geothermal resources, hybrid geothermal-fossil fuel power plant configurations offer another alternative to reduce fossil-fuel consumption and greenhouse gas emissions. Zhou [67] also studies a 500 MW hybrid geothermal-coal configuration with a 210 °C reservoir temperature and 400 kg/s brine flow rate. Results show savings of up to 0.3 million tonnes of coal per year and reductions of up to 0.72 million tonnes of GHE per year [77]. Furthermore, a decrease between 33% and 87% in electricity cost compared with a standalone geothermal power plant can be reached along with an increase of up to 19% in electricity production in comparison with a sole coal-fired power plant [67].

Oil and gas fields are also potential for power production and direct usage of geothermal heat [78]. Reyes [79] has studied 349 abandoned onshore oil and gas wells concluding that  $1.7 \times 10^9$  kWh can be added to the New Zealand electricity network. Kurevija and Vulin [80] similarly analyse three gas fields in Croatia showing that geothermal energy

**Table 5**  
Thermodynamic equations for binary geothermal power plants [14].

| State                             | Equations                                                                               |      |
|-----------------------------------|-----------------------------------------------------------------------------------------|------|
| Turbine expansion process         | $w_1 = h_1 - h_2$                                                                       | (37) |
|                                   | $\eta_t = \frac{h_1 - h_2}{h_1 - h_{2s}}$                                               | (38) |
|                                   | $\dot{W}_t = \dot{m}_{wf} w_1 = \dot{m}_{wf} \eta_t (h_1 - h_{2s})$                     | (39) |
|                                   | $\dot{W}_e = \eta_g \dot{W}_t$                                                          | (40) |
| Condensing process                | $\dot{Q}_c = \dot{m}_{wf} (h_2 - h_3)$                                                  | (41) |
| Feed pump                         | $\dot{W}_p = \dot{m}_{wf} (h_4 - h_3)$                                                  | (42) |
| Heat exchange process at E and PH | $\dot{m}_b (h_a - h_c) = \dot{m}_{wf} (h_1 - h_4)$                                      | (43) |
|                                   | $PH: \dot{m}_b \bar{c}_b (T_a - T_c) = \dot{m}_{wf} (h_5 - h_4)$                        | (44) |
|                                   | $E: \dot{m}_b \bar{c}_b (T_a - T_c) = \dot{m}_{wf} (h_1 - h_5)$                         | (45) |
|                                   | $\dot{Q}_E = \dot{m}_b \bar{c}_b (T_a - T_b) = \dot{m}_{wf} (h_1 - h_5)$                | (46) |
|                                   | $\dot{Q}_{PH} = \dot{m}_b \bar{c}_b (T_b - T_c) = \dot{m}_{wf} (h_5 - h_4)$             | (47) |
|                                   | $\eta_{th} \equiv \frac{\dot{W}_{net}}{\dot{Q}_{PH/E}}$                                 | (48) |
|                                   | $\dot{W}_{net} = \dot{Q}_{PH/E} - \dot{Q}_c; \dot{Q}_{PH/E} = \dot{Q}_E + \dot{Q}_{PH}$ | (49) |
|                                   | $\eta_{th} = 1 - \frac{h_2 - h_3}{h_1 - h_4}$                                           | (50) |

**Table 6**  
Working fluids commonly used in binary geothermal plants [14].

| Fluid     | Formula | CT °C | PC MPa | PS @ 300 k MPa |
|-----------|---------|-------|--------|----------------|
| Propane   | C3H8    | 96.9  | 4.24   | 0.9935         |
| i-Butane  | i-C4H10 | 135.9 | 3.69   | 0.3727         |
| n-Butane  | C4H10   | 150.8 | 3.72   | 0.2559         |
| i-Pentane | i-C5H12 | 187.8 | 3.41   | 0.0975         |
| n-Pentane | C5H12   | 193.9 | 3.24   | 0.0738         |
| Ammonia   | NH3     | 133.6 | 11.63  | 1.061          |
| Water     | H2O     | 374.1 | 22.09  | 0.003536       |

production from abandoned gas fields could be economically feasible. Davis and Michaelides [81] found that up to 3 MW of electric power could be produced from abandoned oil wells in South Texas region. Similar studies can be found in [82–86].

Very little was found in the literature on the hybridisation of geothermal and biomass power plants. Thain and DiPippo [24] study the hybrid concept to achieve greater power output in a hybrid geothermal-biomass power plant. Results demonstrate that net power increases 32% in comparison with the operation of the two stand-alone power plants. Moret, Peduzzi [87] also presents the results of hybrid geothermal-biomass study. Overall, innovative hybrid geothermal-biomass systems show positive synergies by using geothermal heat to increase the biomass conversion processes efficiency.

The review of the up to date geothermal power plants has included the single-flash configuration, the double-flash configuration, the dry-steam configuration, the binary configuration and advanced hybrid configurations. All of these power cycles are capable of providing geothermal energy (geo-fluid) at lower temperatures for direct heat purposes after electricity generation. Next, the literature review explores the different configurations of direct uses of the geothermal heat flow after its use in the power plant known as cascade applications. This kind of geothermal development not only maximises thermal use of the geo-fluid by its use in electric and non-electric applications, but also the impact of the geothermal project in local communities.

## 2.6. General considerations

A single-flash plant requires approximately 1200 m<sup>2</sup>/MW, while a coal-fired plant needs 40,000 m<sup>2</sup>/MW and a photovoltaic plant needs 66,000 m<sup>2</sup>/MW [14], which makes it an economical option in terms of land required [45]. There are other environmental concerns regarding geothermal power plants in general, for example, water pollution, noise and visual pollution, water and land usage, greenhouse gases, and loss of natural beauty [18]. However, Bayer, Rybach [47] argue that there are several methods to abate these environmental issues, such as re-injection for surface water pollution, the use of mufflers and silencers for noise pollution, air-cooled condensers for water usage, and avoiding developments in national parks. In general, geothermal power plants produce a lower land impact and greenhouse gases than fossil-fuel-fired conventional power plants.

Geothermal uses configurations typically look at cascade applications using the brine first in producing electricity and then to heating purposes [88]. In this regard, geothermal heat sources at temperatures higher than 150 °C are enable to combine heat and power generation [28]. So, the condensing temperature, generally above 60 °C, is suitable for district heating or other direct heat applications.

## 3. Geothermal direct use technology

Non-electrical applications use heat energy directly from the geo-fluid to complete an extensive range of applications, which usually require a temperature range between 10 °C and 150 °C approximately [88,89]. Also, known as direct uses (DUs), these applications overtake both the economic limit of geothermal power generation temperatures and the poor thermodynamic performance of fossil fuels used for heating resulting in improved use of geothermal energy resources [90]. As a result of the identification and development of direct heat applications worldwide, currently 82 countries report direct utilisation of geothermal energy with an estimated installed thermal power at 70.33 GWt globally, at a growth rate of 7.7% annually and capacity factor of 0.265 [28,31,91]. Lund and Boyd [28] assess the global thermal energy used, which reaches 587,786 TJ/yr (163,287 GWh/yr), growing at a compound rate of 6.8% annually and identifying nine categories of utilisation: geothermal heat pumps, space heating, greenhouse heating,

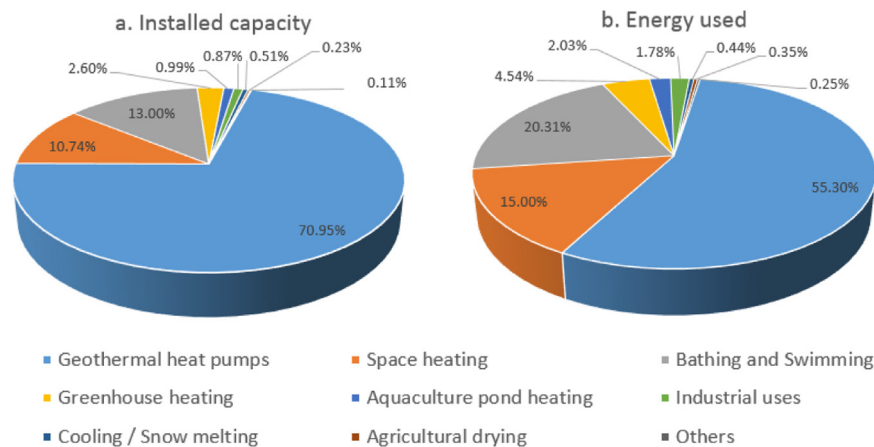


Fig. 10. Geothermal direct applications worldwide in 2015, distributed by a. Percentage of total installed capacity (MWt) and, b. Percentage of total energy used (TJ/yr) [28].

aquaculture pond heating, industrial uses, bathing and swimming, cooling and snow melting, and others (Fig. 10). The most striking finding is that, in 2015, 350 million barrels (52.5 million tonnes) of equivalent oil were saved and 148 million tonnes of CO<sub>2</sub> were prevented from being released to the atmosphere [28].

Fig. 11 summarises the DU of geothermal energy ranging from industrial applications at high temperatures, to aquaculture at very low temperatures. The versatility of DU can take advantage of the same resource to meet thermal requirements or to base combined heat and power configurations (CHP) [92]. In CHP, the thermal content, of either ‘waste heat’ or geo-fluid after the power generation process, is used to meet the required temperature in DU applications. Geothermal heat

pumps play a vital role in space heating in cold zones [93–96]. Additionally, district heating by using low enthalpy geothermal resources is another very mature technology [97–101].

Recent research has demonstrated the positive impacts of cascade applications in geothermal development. The use of geothermal resources in cascade configurations include not only electricity generation but also direct use of thermal energy [4101–104], drying and dehydration processes [30,33], heat pumps [70,95,105,106], fish farming [102] and swimming pools for recreational activities [107]. Cascading systems allow multiple applications of CHP linked to the same geothermal resource [90]. In the cascade design, different temperatures of the same geothermal heat flow are used in staging and successive

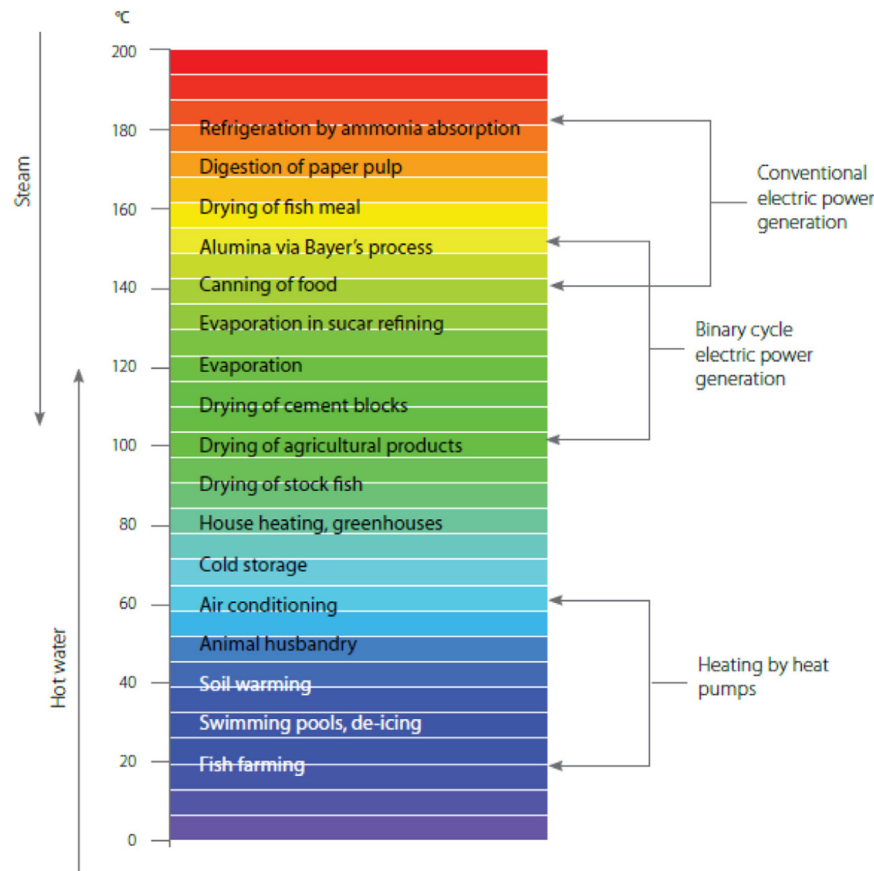


Fig. 11. Lindal diagram for direct geothermal applications [92].

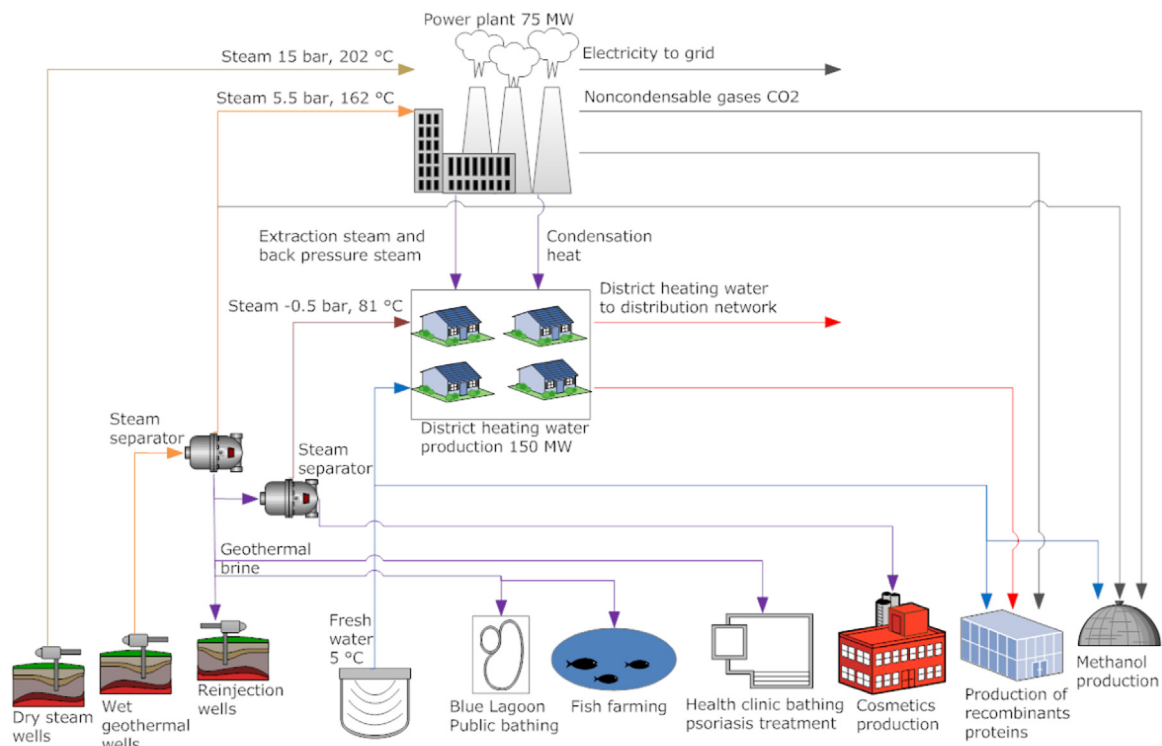


Fig. 12. Cascade application of geothermal resources, the example of the Blue Lagoon, Svartsengi Resource Park, Iceland [27].

applications in a sequence that requires lower temperatures downstream [26,89]. Gudmundsson [90] exemplifies the cascade system by a facility that uses the geo-fluid for different applications. The geo-fluid leaving the power plant at an optimum temperature is used to heat a cucumber and tomato greenhouse, then piped through cabbage, carrots and other vegetable fields. This is an example of power generation, greenhouse and soil heating as cascading use. Bloomquist, Lund [26] reveal that considering individual direct uses and power generation projects may not guarantee an attractive investment return due to the high initial capital cost, whereas a multistage utilisation of the same geothermal heat flow maximises the socio-economic benefits of the development.

Fig. 12 provides an example of a combined heat and power configuration in a multipurpose cascade design. In this Fig., Valdimarsson [27] illustrates how the same geothermal heat flow (at 202 °C and 162 °C) is used to produce electricity, then, when it leaves the power plant (at 81 °C), is used for district heating purpose and finally at a lower temperature, the geo-fluid is applied in other different uses.

The US Agency for International Development (USAID) developed a ranking methodology of geothermal DU and described the socio-economic benefits of DU developments. The analysis of USAID [92] highlights eight factors for ranking geothermal DU applications allocating their weights: geothermal DU resource potential (20%), process energy requirements (15%), market demand (15%), investment potential (15%), employment potential (15%), socio-cultural fit (10%), environmental impacts (5%), and replicability potential (5%). Additionally, the USAID study identifies seven socio-economic and environmental benefits from the development of geothermal DU projects: product processing costs is reduced and product quality is improved; nutrition and household food security is improved; employment opportunities in rural areas are increased; incidence of rural poverty is reduced and family income is increased; employment opportunities for women and youth are enhanced; national capacity is strengthened through use of modern technologies and know-how; and environment is preserved through promoting the use of clean renewable energy [92].

#### 4. Discussion and concluding remarks

From the review conducted, geothermal power plant technology and direct use applications are alternatives for decreasing worldwide fossil-fuel dependence and its environmental impacts. Stefansson [108] carried out a world geothermal resource assessment estimating a lower limit of geothermal potential for electricity generation at 1.5 TW. Stefansson also found that approximately 68% of the total geothermal resources are temperatures lower than 130 °C (mostly for direct heat applications) and the remaining resources are temperatures higher than 130 °C (suitable for electricity generation). Thus, Binary – Organic Ranking Cycle Power Plants might play a vital role in the exploitation of low temperature geothermal resources [109]. Furthermore, although hybrid geothermal-solar thermal configurations have been in-depth studied, there is a need for research in hybrid geothermal-biomass configurations. Both solar and biomass resources increase the energy output increasing the thermal efficiency and increasing the life of the geothermal reservoir. On the other hand, direct applications of geothermal heat present good opportunities for increasing the revenue of a geothermal project. Depending of the geographic zone, multiple direct uses can be achieved. Cascade configurations contribute to maximise the use of geo-heat contributing to increase the standard of living of the communities around the geothermal resource. Research opportunities are identified in hybrid configurations for poly-generation purposes including electricity along with heat, air conditioning, refrigeration, drying, evaporation, district heating among others.

#### Acknowledgements

D.M. has been funded by the Ecuadorian Secretariat for Higher Education, Science, Technology and Innovation (SENESCYT- Secretaría de Educación Superior, Ciencia, Tecnología e Innovación) Award No. CZ03–35-2017, The Technical University of Ambato (UTA - Universidad Técnica de Ambato), Award No. 1895-CU-P-2017 (Resolución), and supported by The Science and Solutions for a Changing Planet Doctoral Training Partnership, Grantham Institute, UK

Natural Environment Research Council (NERC) at Imperial College London. The authors thanks Mr Álvaro Andrade for his support on figures development. The Institute for Applied Sustainability Research (ISUR) supports international research on global sustainability applied to the Global South. C.A. acknowledges the Renewable Energy and Web Architecture – Research & Development, REWA-RD group, Facultad de Ingeniería en Sistemas, Electrónica e Industrial, UTA, for the support to prepare this article.

## References

- [1] Christensen JL, Hain DS. Knowing where to go: the knowledge foundation for investments in renewable energy. *Energy Res Social Sci* 2017;25:124–33.
- [2] Noailly J, Shestakova V. Knowledge spillovers from renewable energy technologies: Lessons from patent citations. *Environmental Innovation and Societal Transitions*.
- [3] Templeton JD, Ghoreishi-Madiseh SA, Hassani F, Al-Khawaja MJ. Abandoned petroleum wells as sustainable sources of geothermal energy. *Energy* 2014;70:366–73.
- [4] Shortall R, Davidsdottir B, Axelsson G. Geothermal energy for sustainable development: a review of sustainability impacts and assessment frameworks. *Renew Sustain Energy Rev* 2015;44(0):391–406.
- [5] Yildirim D, Ozgener L. Thermodynamics and exergoeconomic analysis of geothermal power plants. *Renew Sustain Energy Rev* 2012;16(8):6438–54.
- [6] Budisulistyo D, Krundieck S. Thermodynamic and economic analysis for the pre-feasibility study of a binary geothermal power plant. *Energy Convers Manag* 2015;103:639–49.
- [7] DiPippo R. Geothermal power plants: evolution and performance assessments. *Geothermics* 2015;53(0):291–307.
- [8] Milora SL, Tester JW. Geothermal energy as a source of electric power. Thermodynamic and economic design criteria 1976.
- [9] Axelsson G, Stefánsson V, Xu Y. Sustainable management of geothermal resources. In: *Proceedings of the Conference Sustainable management of geothermal resources*. p. 40–8.
- [10] Chen J, Jiang F. Designing multi-well layout for enhanced geothermal system to better exploit hot dry rock geothermal energy. *Renew Energy* 2015;74(0):37–48.
- [11] Yang S-Y, Yeh H-D. Modeling heat extraction from hot dry rock in a multi-well system. *Appl Therm Eng* 2009;29(8–9):1676–81.
- [12] Bai M, Reinicke KM, Teodoru C, Fichter C. Investigation on water–rock interaction under geothermal hot dry rock conditions with a novel testing method. *J Pet Sci Eng* 2012;90–91(0):26–30.
- [13] Armstead HCH. *Geothermal energy*. Second ed. London, New York: John Wiley & Sons; 1978.
- [14] DiPippo R. *Geothermal power plants: principles, applications, case studies and environmental impact*. 3rd edition Butterworth-Heinemann; 2012.
- [15] Johansson T, Burnham L. *Renewable energy: sources for fuels and electricity*. The United States of America: Island press; 1993.
- [16] Kiryukhin AV. High-temperature fluid flows in the dachny field of the Mutnovsky hydrothermal system, Russia. *Geothermics* 1993;22(1):49–64.
- [17] Shang S, Horne RN, Ramey Jr HJ. Water vapor adsorption on geothermal reservoir rocks. *Geothermics* 1995;24(4):523–40.
- [18] Braun GW, McCluer PH. Geothermal power generation in United States. *Proc IEEE* 1993;81(3):434–48.
- [19] Zarrouk SJ, Purnanto MH. Geothermal steam-water separators: design overview. *Geothermics* 2015;53(0):236–54.
- [20] Eslami-Nejad P, Ouzzane M, Aidoun Z. Modeling of a two-phase CO<sub>2</sub>-filled vertical borehole for geothermal heat pump applications. *Appl Energy* 2014;114(0):611–20.
- [21] Kipsang C. Cost model for geothermal wells. *United Nations University - GEOTHERMAL TRAINING PROGRAMME Reports* 2013, Reykjavik, Iceland. 2014;11.
- [22] Rickard B. *Drilling and testing geothermal wells*. Geothermal Resource Group. The World Bank; 2012.
- [23] Zarrouk SJ, Moon H. Response to the Comments by Ronald DiPippo on “efficiency of geothermal power plants: a worldwide review”. *Geothermics* 2015;53(0):550–3.
- [24] Thain I, DiPippo R. Hybrid geothermal-biomass power plants: applications, designs and performance analysis. In: *Proceedings of the World Geothermal Congress* 2015. Melbourne, Australia: International Energy Association; 2015.
- [25] Valdimarsson P. New development in the ORC technology Santa Tecla, El Salvador: Presented at In: *Proceedings of the Short Course VI on Utilization of Low- and Medium-Enthalpy Geothermal Resources and Financial Aspects of Utilization* organized by UNU-GTP and LaGeo, in Santa Tecla, El Salvador; 2014. p. 1–10.
- [26] Bloomquist G, Lund J, Gehringer M. *The world scientific handbook of energy*. Geothermal Energy World Scientific Publishing Co Pte Ltd; 2013.
- [27] Valdimarsson P. Short course: Electricity Generation from Low Temperature Geothermal Resources. *Conference Short course: Electricity Generation from Low Temperature Geothermal Resources*, Melbourne, Australia vol. 5. Presented at 'WGC2015'.
- [28] Lund J, Boyd T. Direct utilization of geothermal energy 2015 worldwide review. In: *Proceedings of the Conference Direct utilization of geothermal energy 2015 worldwide review*, Melbourne, Australia, 19–25 April 2015. International Geothermal Association.
- [29] Cook D, Davidsdottir B, Petursson JG. Accounting for the utilisation of geothermal energy resources within the genuine progress indicator—A methodological review. *Renew Sustain Energy Rev* 2015;49(0):211–20.
- [30] USAID. *Priority Geothermal Direct-Use Applications for Kenya: A Pre-feasibility Study for Crop Drying*. Washington, The USA: US Agency for International Development (USAID), The Volunteers for Economic Growth Alliance (VEGA), Powering African Agriculture Project (PAA) and Land O'Lakes Inc; 2013.
- [31] Lund J, Freeston D, Boyd T. Direct utilization of geothermal energy 2010 worldwide review. *Geothermics* 2011;40(3):159–80.
- [32] Bertani R. *Geothermal power generation in the world 2010–2014 update report*. *Geothermics* 2016;60:31–43.
- [33] Lund JW, Boyd TL. *Direct utilization of geothermal energy 2015 worldwide review*. *Geothermics* 2016;60:66–93.
- [34] Gehringer M, Loksha V. *Geothermal handbook: planning and financing power generation*. Energy Sector Management Assistance Program (ESMAP). The International Bank for Reconstruction and Development, The World Bank Group, Washington DC, United States, Energy Sector Management Assistance Program technical report 02/12, 164 pp.; 2012. p. 164.
- [35] Bertani R. *Geothermal Power Generation in the World 2010–2014, Update Report*. In: *Proceedings of the World Geothermal Congress 2015 - International Geothermal Association*. 2015.
- [36] Valdimarsson P. Geothermal power plant cycles and main components Presented at In: *Proceedings of the Short Course on Geothermal Drilling, Resource Development and Power Plants* organized by UNU-GTP and LaGeo, in Santa Tecla, El Salvador. 2011.
- [37] Valdimarsson P. *Geothermal power generation [Hessen Energy, Enex]*. University of Iceland; 2008.
- [38] Ayub M, Mitsos A, Ghasemi H. Thermo-economic analysis of a hybrid solar-binary geothermal power plant. *Energy* 2015(0).
- [39] DiPippo R. Geothermal energy Electricity generation and environmental impact. *Energy Policy* 1991;19(8):798–807.
- [40] Zarrouk SJ, Moon H. Efficiency of geothermal power plants: a worldwide review. *Geothermics* 2014;51(0):142–53.
- [41] DiPippo R. *Small geothermal power plants: design, performance and economics*. *GHC Bull* 1999:1.
- [42] SmartDraw. *Engineering library*. San Diego, CA 92131, The USA: Smart Draw Software LLC; 2015.
- [43] Yildirim N. Modelling, simulation and optimization of flashed-steam geothermal power plants from the point of view of non-condensable gas removal systems. Turkey: Izmir Institute of Technology; 2010.
- [44] Yari M. Exergetic analysis of various types of geothermal power plants. *Renew Energy* 2010;35(1):112–21.
- [45] Chamorro CR, Mondéjar ME, Ramos R, Segovia JJ, Martín MC, Villamañán MA. World geothermal power production status: energy, environmental and economic study of high enthalpy technologies. *Energy* 2012;42(1):10–8.
- [46] Çengel YA, Boles MA. *Thermodynamics: an engineering approach*. New York: McGraw-Hill; 2015.
- [47] Bayer P, Rybach L, Blum P, Brauchler R. Review on life cycle environmental effects of geothermal power generation. *Renew Sustain Energy Rev* 2013;26(0):446–63.
- [48] Aikawa K, Soda M. Advanced design in Hatchobaru geothermal power station. In: *Proceedings of the Conference Advanced design in Hatchobaru geothermal power station*, vol. 3. US Government Printing Office Washington, DC, USA, p. 1881–8.
- [49] Dickson MH, Fanelli M. *Geothermal energy: utilization and technology*. Routledge; 2013.
- [50] Kopuničová M. Feasibility study of binary geothermal power plants in Eastern Slovakia, analysis of ORC and Kalina power plants [Master]. University of Iceland & the University of Akureyri; 2008.
- [51] Kalina A, Leibowitz H. Application of the Kalina cycle technology to geothermal power generation. *Trans-Geotherm Resour Counc* 1989;13:605–11.
- [52] Zhang X, He M, Zhang Y. A review of research on the Kalina cycle. *Renew Sustain Energy Rev* 2012;16(7):5309–18.
- [53] DiPippo R. Second Law assessment of binary plants generating power from low-temperature geothermal fluids. *Geothermics* 2004;33(5):565–86.
- [54] DiPippo R. *Geotherm Power Plants* 2008.
- [55] Bao J, Zhao L. A review of working fluid and expander selections for organic Rankine cycle. *Renew Sustain Energy Rev* 2013;24:325–42.
- [56] DiPippo R. Ideal thermal efficiency for geothermal binary plants. *Geothermics* 2007;36(3):276–85.
- [57] Quoilin S, Declaye S, Legros A, Guillaume L, Lemort V. Working fluid selection and operating maps for Organic Rankine Cycle expansion machines. In: *Proceedings of the Conference Working fluid selection and operating maps for Organic Rankine Cycle expansion machines*. p. 10.
- [58] Mikielewicz D, Mikielewicz J. A thermodynamic criterion for selection of working fluid for subcritical and supercritical domestic micro CHP. *Appl Therm Eng* 2010;30(16):2357–62.
- [59] Quoilin S, Broek MVD, Declaye S, Dewallef P, Lemort V. Techno-economic survey of Organic Rankine Cycle (ORC) systems. *Renew Sustain Energy Rev* 2013;22:168–86.
- [60] Astolfi M, Romano MC, Bombarda P, Macchi E. Binary ORC (organic Rankine cycles) power plants for the exploitation of medium–low temperature geothermal sources – Part A: thermodynamic optimization. *Energy* 2014;66:423–34.
- [61] Astolfi M, Romano MC, Bombarda P, Macchi E. Binary ORC (Organic Rankine Cycles) power plants for the exploitation of medium–low temperature geothermal sources – Part B: techno-economic optimization. *Energy* 2014;66:435–46.
- [62] Astolfi M, Xodo L, Romano MC, Macchi E. Technical and economical analysis of a solar-geothermal hybrid plant based on an Organic Rankine Cycle. *Geothermics*

- 2011;40(1):58–68.
- [63] Peterseim JH, Hellwig U, Tadros A, White S. Hybridisation optimization of concentrating solar thermal and biomass power generation facilities. *Sol Energy* 2014;99(0):203–14.
- [64] Peterseim JH, White S, Tadros A, Hellwig U. Concentrated solar power hybrid plants, which technologies are best suited for hybridisation? *Renew Energy* 2013;57(0):520–32.
- [65] Peterseim JH, White S, Tadros A, Hellwig U. Concentrating solar power hybrid plants – Enabling cost effective synergies. *Renew Energy* 2014;67(0):178–85.
- [66] Bundschuh J, Ghaffour N, Mahmoudi H, Goosen M, Mushtaq S, Hoinkis J. Low-cost low-enthalpy geothermal heat for freshwater production: innovative applications using thermal desalination processes. *Renew Sustain Energy Rev* 2015;43(0):196–206.
- [67] Zhou C. A fundamental study on hybrid geothermal energy systems| NOVA. The University of Newcastle's Digital Repository. Australia: The University of Newcastle; 2014.
- [68] Ayub M, Mitsos A, Ghasemi H. Thermo-economic analysis of a hybrid solar-binary geothermal power plant. *Energy* 2015;87:326–35.
- [69] Cardemil JM, Cortés F, Díaz A, Escobar R. Thermodynamic evaluation of solar-geothermal hybrid power plants in northern Chile. *Energy Convers Manag* 2016;123:348–61.
- [70] Choi J, Kang B, Cho H. Performance comparison between R22 and R744 solar-geothermal hybrid heat pumps according to heat source conditions. *Renew Energy* 2014;71:414–24.
- [71] Ghasemi H, Sheu E, Tizzanini A, Paci M, Mitsos A. Hybrid solar–geothermal power generation: optimal retrofitting. *Appl Energy* 2014;131:158–70.
- [72] Jiang P-X, Zhang F-Z, Xu R-N. Thermodynamic analysis of a solar-enhanced geothermal hybrid power plant using CO<sub>2</sub> as working fluid. *Appl Therm Eng* 2017.
- [73] Kim W, Choi J, Cho H. Performance analysis of hybrid solar-geothermal CO<sub>2</sub> heat pump system for residential heating. *Renew Energy* 2013;50:596–604.
- [74] Zhou C. Hybridisation of solar and geothermal energy in both subcritical and supercritical Organic Rankine Cycles. *Energy Convers Manag* 2014;81:72–82.
- [75] Zhou C, Doroodchi E, Moghtaderi B. An in-depth assessment of hybrid solar–geothermal power generation. *Energy Convers Manag* 2013;74:88–101.
- [76] Zhou C, Doroodchi E, Munro I, Moghtaderi B. A feasibility study on hybrid solar–geothermal power generation. In: *Proceedings of the Conference A feasibility study on hybrid solar–geothermal power generation*.
- [77] Zhou C, Doroodchi E, Moghtaderi B. Assessment of geothermal assisted coal-fired power generation using an Australian case study. *Energy Convers Manag* 2014;82:283–300.
- [78] Harvey C. Oil and gas wells find new life with geothermal. *New Sci* 2011;212(2839):28.
- [79] Reyes AG. Abandoned oil and gas wells: a reconnaissance study of an unconventional geothermal resource. *GNS Sci* 2007.
- [80] Kurevija T, Vulin D. High enthalpy geothermal potential of the deep gas fields in Central Drava Basin, Croatia. *Water Resour Manag* 2011;25(12):3041–52.
- [81] Davis AP, Michaelides EE. Geothermal power production from abandoned oil wells. *Energy* 2009;34(7):866–72.
- [82] Alimonti C, Gnani AA. Harnessing the fluids heat to improve mature oil field: the Villafortuna–Trecate case study. *J Pet Sci Eng* 2015;125:256–62.
- [83] Kharseh M, Al-Khawaja M, Hassani F. Utilization of oil wells for electricity generation: performance and economics. *Energy* 2015;90(Part1):910–6.
- [84] Liu J, Sun L, Wu X, Yao J. Feasibility of combination of CO<sub>2</sub> geological storage with geothermal-type water-soluble gas recovery in Yinggehai Basin, China. *Int J Greenh Gas Control* 2016;45:139–49.
- [85] Noorollahi Y, Pourarshad M, Jalilinasrabady S, Yousefi H. Numerical simulation of power production from abandoned oil wells in Ahwaz oil field in southern Iran. *Geothermics* 2015;55:16–23.
- [86] Tutuncu AN, Bui BT. A coupled geomechanics and fluid flow model for induced seismicity prediction in oil and gas operations and geothermal applications. *J Nat Gas Sci Eng* 2016;29:110–24.
- [87] Moret S, Peduzzi E, Gerber L, Maréchal F. Integration of deep geothermal energy and woody biomass conversion pathways in urban systems. *Energy Convers Manag* 2016;129:305–18.
- [88] Anderson D, Lund J. Direct utilization of geothermal energy: a technical handbook. 1979. p. 249. (p. Medium: ED; Size: Pages: 249).
- [89] Glassley WE. Geothermal energy: renewable energy and the environment. Boca Raton: CRC Press/Taylor & Francis; 2015.
- [90] Gudmundsson J-S. The elements of direct uses. *Geothermics* 1988;17(1):119–36.
- [91] Lund J, Freeston D, Boyd T. Direct application of geothermal energy: 2005 Worldwide review. *Geothermics* 2005;34(6):691–727.
- [92] USAID. Geothermal Direct-Use Guidebook - A case study for Kenya. Washington, The USA: US Agency for International Development (USAID), The Volunteers for Economic Growth Alliance (VEGA), Powering African Agriculture Project (PAA) and Land O'Lakes Inc; 2013.
- [93] Antonijevic D, Komatina M. Sustainable sub-geothermal heat pump heating in Serbia. *Renew Sustain Energy Rev* 2011;15(8):3534–8.
- [94] Eslami-Nejad P, Ouzzane M, Aidoun Z. Modeling of a two-phase CO<sub>2</sub>-filled vertical borehole for geothermal heat pump applications. *Appl Energy* 2014;114:611–20.
- [95] Fossa M. The temperature penalty approach to the design of borehole heat exchangers for heat pump applications. *Energy Build* 2011;43(6):1473–9.
- [96] Naili N, Hazami M, Attar I, Farhat A. Assessment of surface geothermal energy for air conditioning in northern Tunisia: direct test and deployment of ground source heat pump system. *Energy Build* 2016;111:207–17.
- [97] Aslan A, Yüksel B, Akyol T. Energy analysis of different types of buildings in Gonen geothermal district heating system. *Appl Therm Eng* 2011;31(14–15):2726–34.
- [98] Hurley MF, Olson CR, Ward LJ, Jaques BJ, Johnson KA, Gunnerson JK, et al. Transgranular stress corrosion cracking of 304L stainless steel pipe clamps in direct use geothermal water heating applications. *Eng Fail Anal* 2013;33:336–46.
- [99] Kerrigan K, Jouhara H, O'Donnell GE, Robinson AJ. Heat pipe-based radiator for low grade geothermal energy conversion in domestic space heating. *Simul Model Pract Theory* 2011;19(4):1154–63.
- [100] Kyriakis SA, Younger PL. Towards the increased utilisation of geothermal energy in a district heating network through the use of a heat storage. *Appl Therm Eng* 2016;94:99–110.
- [101] Pujol M, Ricard LP, Bolton G. 20 years of exploitation of the Yarragadee aquifer in the Perth Basin of Western Australia for direct-use of geothermal heat. *Geothermics* 2015;57:39–55.
- [102] Climo M, Milicich SD, White B. A history of geothermal direct use development in the Taupo volcanic zone, new Zealand. *Geothermics* 2016;59(Part B):215–24.
- [103] Zheng B, Xu J, Ni T, Li M. Geothermal energy utilization trends from a technological paradigm perspective. *Renew Energy* 2015;77(0):430–41.
- [104] Shortall R, Davidsdottir B, Axelsson G. Development of a sustainability assessment framework for geothermal energy projects. *Energy Sustain Dev* 2015;27:28–45.
- [105] Self SJ, Reddy BV, Rosen MA. Geothermal heat pump systems: status review and comparison with other heating options. *Appl Energy* 2013;101(0):341–8.
- [106] Lubis LI, Kanoglu M, Dincer I, Rosen MA. Thermodynamic analysis of a hybrid geothermal heat pump system. *Geothermics* 2011;40(3):233–8.
- [107] Rubio-Maya C, Ambríz Díaz VM, Pastor Martínez E, Belman-Flores JM. Cascade utilization of low and medium enthalpy geothermal resources – A review. *Renew Sustain Energy Rev* 2015;52:689–716.
- [108] Stefansson V. World geothermal assessment. In: *Proceedings of the Conference World geothermal assessment*. p. 24–9.
- [109] Moya D, Paredes J, Kaparaju P. Technical, financial, economic and environmental pre-feasibility study of geothermal power plants by RETScreen – Ecuador's case study. *Renew Sustain Energy Rev* 2018;92:628–37.